

# Environmental Emissions Data for Pickering Nuclear

Q2 2022

## OVERVIEW

This report summarizes Pickering Nuclear's environmental emissions data for Q2 2022. Pickering Nuclear Generating Station has six operating reactor units and a total generation capacity of 3,094 megawatts. The station is located in the City of Pickering in Durham Region.

This report includes:

- Radioactive Effluents: Releases to air and water remained well below the regulatory limits.
- Pickering Waste Management Facility: Monitoring results for air emissions, water, and perimeter dose rate confirmed the integrity of the facility.
- Groundwater Monitoring: OPG continued to analyze groundwater results to examine trends.
- Spills to the Environment: There were no spills to the environment that was reportable to a regulatory authority.

Note: The contents of this report are consistent with environmental data OPG is required to provide to the Canadian Nuclear Safety Commission (CNSC) on a quarterly basis. These reporting requirements are periodically revised.

## ENVIRONMENTAL EMISSIONS MANAGEMENT

OPG has an environmental management program to ensure its activities are conducted in a manner that minimizes any adverse impact on the public and the environment. OPG's environmental program conforms to CNSC requirements for environmental protection and the International Organization for Standardization (ISO) standard for environmental management systems. The quality assurance programs for OPG's chemistry and health physics laboratories conform to the requirements of national and international standards.

As part of OPG's environmental management program, OPG has established an effluent monitoring and control program that is based on the "ALARA" principle. That is, measures are in place to ensure emissions to the environment are kept As Low As Reasonably Achievable while taking social and economic factors into account.

## MONITORING OF RADIOACTIVE EFFLUENTS

### Release Limits & Action Levels

OPG uses [radiation dose limits](#) specified in federal legislation to derive Release Limits for the radionuclides that may be released to air and water from its nuclear facilities. Pickering Nuclear must maintain its radiological emissions well below these limits to meet the terms of its operating licence.


OPG also sets Action Levels that are much lower than the Release Limits to identify and control emissions before a limit can be reached.

### Public Radiation Dose Data

*The radiation dose to the public resulting from the operation of Pickering Nuclear is a very small fraction of the estimated annual average background radiation dose around the station.*

*Annual environmental monitoring program results for Pickering Nuclear, including an assessment of radiation dose to the public, are available at:*  
[www.opg.com/news-and-media/Pages/reports.aspx](http://www.opg.com/news-and-media/Pages/reports.aspx)

Natural Background Radiation <99.9%

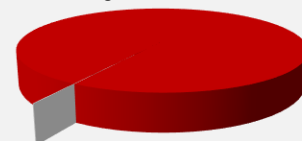

Pickering Nuclear Contribution <0.1%


# Environmental Emissions Data for Pickering Nuclear

Q2 2022


## Performance Results

Pickering Nuclear's emissions to the environment are monitored to track performance. For Q2 2022, Pickering Nuclear's radiological emissions to air and water remained well below the Release Limits and no Action Levels were exceeded. (Appendix A, Tables A.1 and A.2) The following graphs show Pickering Nuclear's radiological emissions for the year to date as a percentage of the Release Limits. Note: Units 2 and 3 are in a safe shutdown state.

### Air Emissions as a Per Cent of Release Limits for Pickering Nuclear Generating Station (A and B)

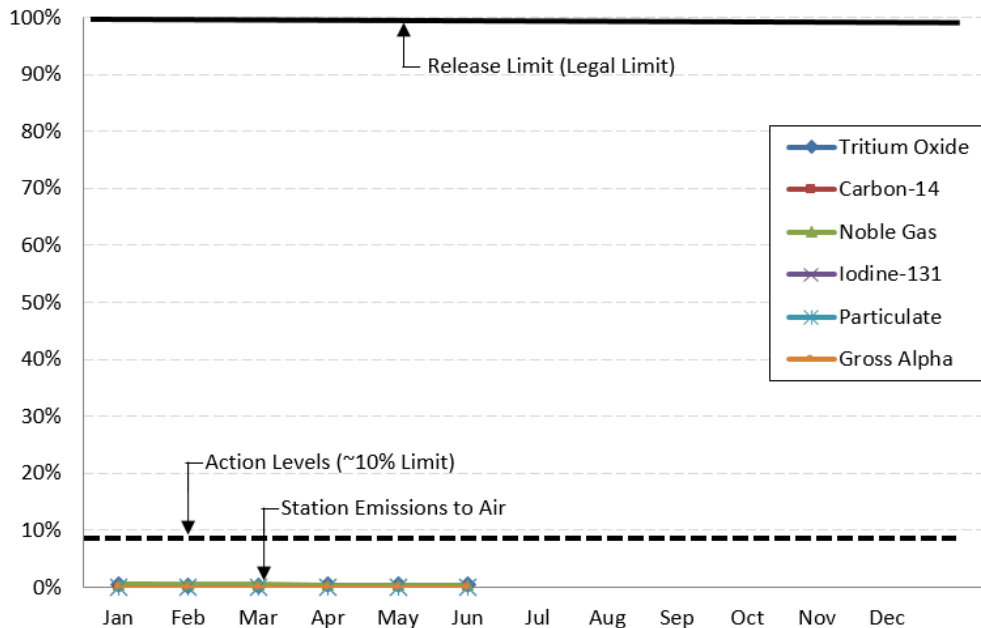

### Water Emissions as a Per Cent of Release Limits for Pickering Nuclear Generating Station (A and B)

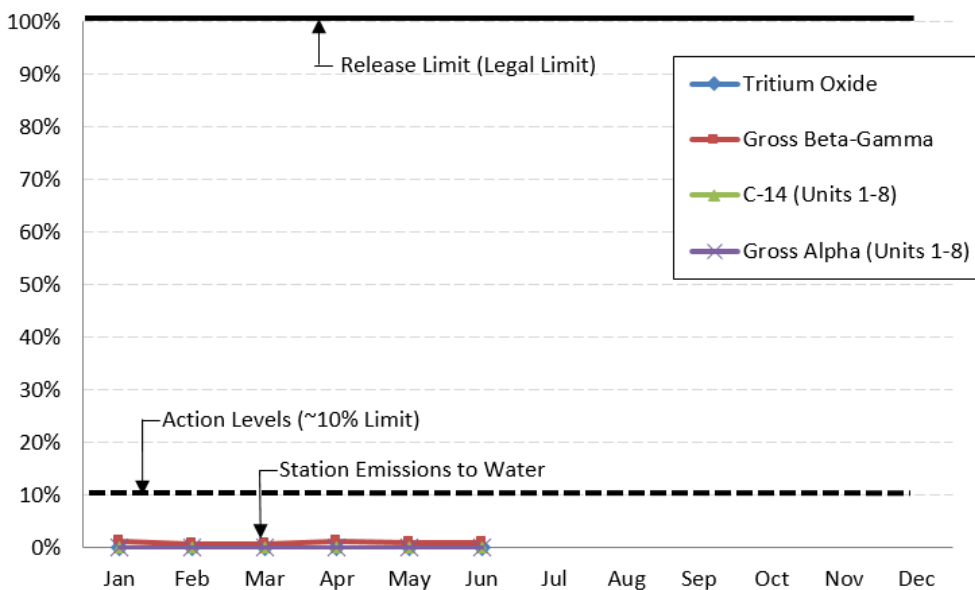

# Environmental Emissions Data for Pickering Nuclear

Q2 2022

## PICKERING WASTE MANAGEMENT FACILITY

Radiological air emissions, water, and radiation dose monitoring requirements for the Pickering Waste Management Facility were met in Q2 2022 and no issues were identified. (Appendix A, Tables A.3, A.4 and A.5)

## GROUNDWATER MONITORING

Groundwater monitoring is conducted at monitoring wells around the Pickering site perimeter, including along the Lake Ontario shoreline, to confirm that there are no adverse off-site impacts from tritium in groundwater. 2020 groundwater monitoring report is available at: [www.opg.com/reporting/regulatory-reporting/](http://www.opg.com/reporting/regulatory-reporting/)

## RELEASES OF HAZARDOUS SUBSTANCES (NON-RADIOACTIVE)

Pickering Nuclear complies with numerous regulatory requirements for controlling and monitoring releases of hazardous substances to the environment. Pickering Nuclear reports releases of hazardous substances to Environment Canada's National Pollutant Release Inventory (NPRI). Tools and resources for accessing, analyzing and interpreting NPRI data are available on the [NPRI website](#). Pickering Nuclear's carbon dioxide emissions are well below the threshold for mandatory reporting to federal and provincial authorities. Greenhouse gas data and information for reporting facilities are available on the [Greenhouse Gas Emissions Reporting Program \(GHGRP\) website](#).

## SPILLS TO THE ENVIRONMENT

OPG has extensive programs to ensure the risk of spills to the environment is effectively assessed and managed. All spills are reported by OPG to the appropriate federal, provincial and municipal authorities as required.

OPG classifies its reportable spills as Category A, B or C spills based on the actual or potential impacts. Category A spills are considered very serious due to the scale of injury or damage, health effects, or safety impairment. Category B spills are considered serious due to localized injury or impacts to property. Category C spills are all other reportable spills that are less serious than Category A and B spills.

There were no reportable spills at Pickering Nuclear in Q2 2022.

## APPENDIX A

### ENVIRONMENTAL EMISSIONS DATA

# Environmental Emissions Data for Pickering Nuclear

Q2 2022

Table A.1: Airborne Radionuclide Releases for Pickering Nuclear Generating Station (A and B)

		Tritium (Bq)	Carbon-14 (Bq)	Noble Gas (Bq-MeV)	Iodine-131 (Bq)	Particulate (Bq)	Gross Alpha (Bq)
<b>SUMMARY: ANNUAL</b>							
<b>Release Limit (Bq/year)<sup>(a)</sup></b>		$1.02 \times 10^{17}$	$2.69 \times 10^{15}$	$2.66 \times 10^{16}$	$2.82 \times 10^{12}$	$4.28 \times 10^{11}$	$7.49 \times 10^{10}$
Total Releases as of Q2 2022		$2.6 \times 10^{14}$	$1.3 \times 10^{12}$	$< 6.3 \times 10^{13}$	$< 6.1 \times 10^6$	$< 4.9 \times 10^5$	$< 4.9 \times 10^6$
<b>DETAILS: WEEKLY<sup>(b)</sup></b>							
<b>Action Level (Bq/week)<sup>(c)</sup></b>		$2.03 \times 10^{14}$	$5.38 \times 10^{12}$	$5.32 \times 10^{13}$	$5.65 \times 10^9$	$8.57 \times 10^8$	Not Applicable <sup>(d)</sup>
Jan.	Week 1	$7.1 \times 10^{12}$	$2.9 \times 10^{10}$	$< 2.1 \times 10^{12}$	$< 1.7 \times 10^5$	$< 8.4 \times 10^4$	$< 1.9 \times 10^4$
	Week 2	$5.7 \times 10^{12}$	$7.1 \times 10^{10}$	$< 3.7 \times 10^{12}$	$< 1.7 \times 10^5$	$< 1.3 \times 10^5$	$< 1.9 \times 10^4$
	Week 3	$8.5 \times 10^{12}$	$4.8 \times 10^{10}$	$< 3.0 \times 10^{12}$	$< 1.7 \times 10^5$	$< 8.7 \times 10^4$	$< 1.9 \times 10^4$
	Week 4	$7.2 \times 10^{12}$	$3.5 \times 10^{10}$	$< 2.7 \times 10^{12}$	$< 1.8 \times 10^5$	$< 1.4 \times 10^5$	$< 1.9 \times 10^4$
	Week 5	$9.7 \times 10^{12}$	$3.6 \times 10^{10}$	$< 2.9 \times 10^{12}$	$< 1.8 \times 10^5$	$< 1.5 \times 10^5$	$< 1.9 \times 10^4$
Feb.	Week 6	$6.8 \times 10^{12}$	$4.0 \times 10^{10}$	$< 1.7 \times 10^{12}$	$< 1.8 \times 10^5$	$< 1.1 \times 10^5$	$< 1.9 \times 10^4$
	Week 7	$6.2 \times 10^{12}$	$3.7 \times 10^{10}$	$< 2.6 \times 10^{12}$	$< 1.7 \times 10^5$	$< 1.2 \times 10^5$	$< 1.9 \times 10^4$
	Week 8	$6.4 \times 10^{12}$	$4.5 \times 10^{10}$	$< 1.7 \times 10^{12}$	$< 1.7 \times 10^5$	$< 9.8 \times 10^4$	$< 1.9 \times 10^4$
	Week 9	$8.5 \times 10^{12}$	$5.6 \times 10^{10}$	$< 4.9 \times 10^{12}$	$< 1.8 \times 10^5$	$< 1.1 \times 10^5$	$< 1.9 \times 10^4$
Mar.	Week 10	$7.5 \times 10^{12}$	$4.2 \times 10^{10}$	$< 2.8 \times 10^{12}$	$< 3.1 \times 10^5$	$< 1.3 \times 10^5$	$< 1.9 \times 10^4$
	Week 11	$7.0 \times 10^{12}$	$3.3 \times 10^{10}$	$< 2.6 \times 10^{12}$	$< 2.4 \times 10^5$	$< 1.8 \times 10^5$	$< 1.9 \times 10^4$
	Week 12	$6.4 \times 10^{12}$	$4.1 \times 10^{10}$	$< 2.4 \times 10^{12}$	$< 2.2 \times 10^5$	$< 1.7 \times 10^5$	$< 1.9 \times 10^4$
	Week 13	$7.6 \times 10^{12}$	$6.5 \times 10^{10}$	$< 2.2 \times 10^{12}$	$< 1.0 \times 10^6$	$< 1.4 \times 10^5$	$< 1.9 \times 10^4$
April	Week 14	$6.1 \times 10^{12}$	$9.8 \times 10^{10}$	$< 2.5 \times 10^{12}$	$< 6.1 \times 10^5$	$< 9.7 \times 10^4$	$< 1.9 \times 10^4$
	Week 15	$7.0 \times 10^{12}$	$5.6 \times 10^{10}$	$< 2.5 \times 10^{12}$	$< 2.4 \times 10^5$	$< 9.7 \times 10^4$	$< 1.9 \times 10^4$
	Week 16	$6.1 \times 10^{12}$	$3.9 \times 10^{10}$	$< 2.0 \times 10^{12}$	$< 2.1 \times 10^5$	$< 9.5 \times 10^4$	$< 1.9 \times 10^4$
	Week 17	$7.7 \times 10^{12}$	$5.8 \times 10^{10}$	$< 1.7 \times 10^{12}$	$< 1.8 \times 10^5$	$< 9.2 \times 10^4$	$< 1.9 \times 10^4$
	Week 18	$1.2 \times 10^{13}$	$4.8 \times 10^{10}$	$< 1.3 \times 10^{12}$	$< 1.7 \times 10^5$	$< 9.3 \times 10^4$	$< 1.9 \times 10^4$
May	Week 19	$1.4 \times 10^{13}$	$7.1 \times 10^{10}$	$< 1.6 \times 10^{12}$	$< 1.7 \times 10^5$	$< 2.2 \times 10^5$	$< 1.9 \times 10^4$
	Week 20	$8.5 \times 10^{12}$	$4.4 \times 10^{10}$	$< 2.3 \times 10^{12}$	$< 1.7 \times 10^5$	$< 1.4 \times 10^5$	$< 1.9 \times 10^4$
	Week 21	$7.3 \times 10^{12}$	$3.8 \times 10^{10}$	$< 2.5 \times 10^{12}$	$< 1.7 \times 10^5$	$< 1.6 \times 10^5$	$< 1.9 \times 10^4$
	Week 22	$7.6 \times 10^{12}$	$5.8 \times 10^{10}$	$< 2.4 \times 10^{12}$	$< 1.7 \times 10^5$	$< 2.6 \times 10^5$	$< 1.9 \times 10^4$
June	Week 23	$6.8 \times 10^{12}$	$3.9 \times 10^{10}$	$< 2.3 \times 10^{12}$	$< 1.7 \times 10^5$	$< 1.3 \times 10^5$	$< 1.9 \times 10^4$
	Week 24	$6.5 \times 10^{12}$	$5.6 \times 10^{10}$	$< 2.2 \times 10^{12}$	$< 1.7 \times 10^5$	$< 1.9 \times 10^5$	$< 1.9 \times 10^4$
	Week 25	$6.6 \times 10^{12}$	$4.2 \times 10^{10}$	$< 2.5 \times 10^{12}$	$< 1.7 \times 10^5$	$< 2.1 \times 10^5$	$< 1.9 \times 10^4$
	Week 26	$1.1 \times 10^{13}$	$3.3 \times 10^{10}$	$< 1.5 \times 10^{12}$	$< 1.7 \times 10^5$	$< 3.4 \times 10^5$	$< 1.9 \times 10^4$

- (a) The derived Release Limit for a given radionuclide is the release rate of that radionuclide to air or surface water during normal operation of a nuclear facility over the period of a calendar year, which would result in an individual receiving a dose equal to the regulatory annual dose limit for a member of the public.
- (b) Analysis of air emissions is conducted weekly to monitor against internal performance targets. Emissions are reported using the fiscal calendar and months contain either four or five weeks. Values prefixed by an "<" indicate that reported results were less than the instrument detection limits.

# Environmental Emissions Data for Pickering Nuclear

Q2 2022

- (c) Exceedances of Action Levels must be reported by OPG to the CNSC. To prevent an Action Level from being reached, OPG has set Internal Investigation Levels that require emissions to be reviewed when they reach the high end of the normal range. Corrective actions are taken if necessary. There were no CNSC Action Level exceedance events in the second quarter of 2022.
- (d) Action Level for gross alpha is not specified because it is not a routinely monitored radionuclide group at Pickering Nuclear as the activity is below the threshold value for monitoring.

**Table A.2: Waterborne Radionuclide Releases to Lake Ontario for Pickering Nuclear Generating Station (A and B)**

	Pickering Nuclear Generating Station (A and B)			
	Tritium (Bq)	Gross Beta-Gamma (Bq)	Carbon-14 (Bq)	Gross Alpha (Bq)
<b>SUMMARY: ANNUAL</b>				
<b>Release Limit (Bq/year)<sup>(a)</sup></b>	$7.87 \times 10^{17}$	$1.87 \times 10^{12}$	$3.75 \times 10^{13}$	$2.36 \times 10^{10}$
Total Releases as of Q2 2022	$2.6 \times 10^{14}$	$1.0 \times 10^{10}$	$9.8 \times 10^8$	$<1.2 \times 10^6$
<b>DETAILS: MONTHLY<sup>(b)</sup></b>				
<b>Action Level (Bq/month)<sup>(c)</sup></b>	$6.29 \times 10^{15}$	$1.49 \times 10^{10}$	$3.00 \times 10^{11}$	Not Applicable <sup>(d)</sup>
January	$5.1 \times 10^{13}$	$2.0 \times 10^9$	$5.4 \times 10^7$	$<2.7 \times 10^5$
February	$3.7 \times 10^{13}$	$1.3 \times 10^9$	$2.3 \times 10^7$	$<1.2 \times 10^5$
March	$3.7 \times 10^{13}$	$1.3 \times 10^9$	$3.5 \times 10^7$	$<1.8 \times 10^5$
April	$4.6 \times 10^{13}$	$2.1 \times 10^9$	$7.5 \times 10^8$	$<2.0 \times 10^5$
May	$4.6 \times 10^{13}$	$1.7 \times 10^9$	$8.2 \times 10^7$	$<1.7 \times 10^5$
June	$4.6 \times 10^{13}$	$1.6 \times 10^9$	$3.3 \times 10^7$	$<1.7 \times 10^5$

- (a) The derived Release Limit for a given radionuclide is the release rate of that radionuclide to air or surface water during normal operation of a nuclear facility over the period of a calendar year, which would result in an individual receiving a dose equal to the regulatory annual dose limit for a member of the public.
- (a) Analysis of water emissions is conducted monthly to monitor against internal performance targets. Monthly emissions are reported using the fiscal calendar and months contain either four or five weeks. Months with five weeks typically report higher releases relative to months with four weeks. For 2022, January, April, July and October have five weeks.
- (b) Exceedances of Action Levels must be reported by OPG to the CNSC. To prevent an Action Level from being reached, OPG has set Internal Investigation Levels that require emissions to be reviewed when they reach the high end of the normal range. Corrective actions are taken if necessary. There were no CNSC Action Level exceedance events in the second quarter of 2022.
- (c) Action Level for gross alpha is not specified since it is not a routinely monitored radionuclide group because its activity is below the threshold value for monitoring.

*A becquerel (Bq) is the standard international unit for measuring radioactive decay or radioactivity. One becquerel is the decay of one atom of a radioisotope per second, and is an extremely small amount of radioactivity. Becquerel is a measure of the rate (not energy) of radiation emission from a source.*

*Another unit of measuring radioactivity is the curie (Ci).  $1 \text{ Ci} = 3.7 \times 10^{10} \text{ Bq}$ .*

# Environmental Emissions Data for Pickering Nuclear

Q2 2022

*While station emissions typically remain at consistently low levels, small fluctuations do occur because of changing operating conditions (e.g. unit outages), work activities, and equipment issues.*

**Table A.3:** Pickering Waste Management Facility Air Sample Results

	<b>Particulate (weekly average Bq)<sup>(a)</sup></b>
April	< 2.2 x 10 <sup>3</sup> (all weeks)
May	< 2.2 x 10 <sup>3</sup> (all weeks)
June	< 2.2 x 10 <sup>3</sup> (all weeks)

(a) Values prefixed by an “<” indicate that reported results were less than the instrument detection limits. Pickering Waste Management Facility particulate results are included in Pickering Nuclear’s airborne radionuclide release data.

**Table A.4:** Pickering Waste Management Facility Water Sample Results

		<b>Gross Beta-Gamma (Bq/mL)<sup>(a)</sup></b>
<b>Sample Point</b>		<b>Q2</b>
Retube Component Storage Facility	Catch Basin 111	< 1.51 x 10 <sup>-2</sup>
	Catch Basin 112	< 1.51 x 10 <sup>-2</sup>
	Catch Basin 77	< 1.51 x 10 <sup>-2</sup>
	Catch Basin 78	< 1.51 x 10 <sup>-2</sup>
	Catch Basin 82	< 1.51 x 10 <sup>-2</sup>
	Catch Basin 83	< 1.51 x 10 <sup>-2</sup>

- (a) Values prefixed by an “<” indicate that reported results were less than the instrument detection limits.
- (b) As per communications in the letters to the CNSC (W-CORR-00531-01762, W-CORR-00531-01785, W-CORR-00531-01791), an assessment was completed and identified that routine storm water and foundation drainage monitoring at the used fuel dry storage buildings is not required per CSA N288 series of standards or OPG standards. The monitoring was discontinued and removed from the Quarterly Operations report starting Q1 2022.

**Table A.5:** Pickering Waste Management Facility Perimeter Fence Dose Rates

		<b>Average Air Kerma Rate (μGy/hour)<sup>(a)</sup></b>
<b>Location</b>		<b>Q2</b>
Retube Component Storage Facility (RCSF)	Pi2, RCSF South	0.072
	Pi3, RCSF East	0.071

# Environmental Emissions Data for Pickering Nuclear

Q2 2022

Location		Average Air Kerma Rate ( $\mu\text{Gy}/\text{hour}$ ) <sup>(a)</sup>
		Q2
Storage Buildings #3 & 4	PW1, North - West	0.065
	PW2, North - Middle	0.084
	PW3, North - East	0.070
	PW4, East - North	0.070
	PW5, East - Middle	0.125
	PW6, East - South	0.221
	PW7, South - East	0.129
	PW8, South - West	0.083
	PW9, West - South	0.078
	PW10, West - Middle	0.127
	PW11, West - North	0.074
Used Fuel Dry Storage Facility (UFDSF) <sup>(b)</sup>	Pu3, UFDSF East Outside	0.239
	Pu4, UFDSF Stage II East1	0.258
	Pu5, UFDSF Stage II East2	0.256

- (a) Average ambient dose rates are measured at perimeter fences by Thermoluminescent Dosimeters to demonstrate that potential doses due to radiation fields from waste management facility operations are well within allowable limits and pose a negligible risk for the public, the workers and the environment. Dose rate monitoring results are compared to an internal target dose rate standard of  $0.5 \mu\text{Gy}/\text{hour}$ . This target is derived from the  $1 \text{ mSv}/\text{year}$  dose limit specified in federal legislation for a member of the public and assumes exposure for a working year (2,000 hours).
- (b) The dosimeters for the Used Fuel Dry Storage Facility are located on facility perimeter wall and have target dose rate of  $<1.75 \mu\text{Gy}/\text{hour}$ . This rate was derived from the target standard of  $0.5 \mu\text{Gy}/\text{hour}$  for the perimeter fence, taking into account the location of the dosimeters.